


Authority

Health and Safety Code Division 2.5, California Code of Regulations, Title 22, Division 9.

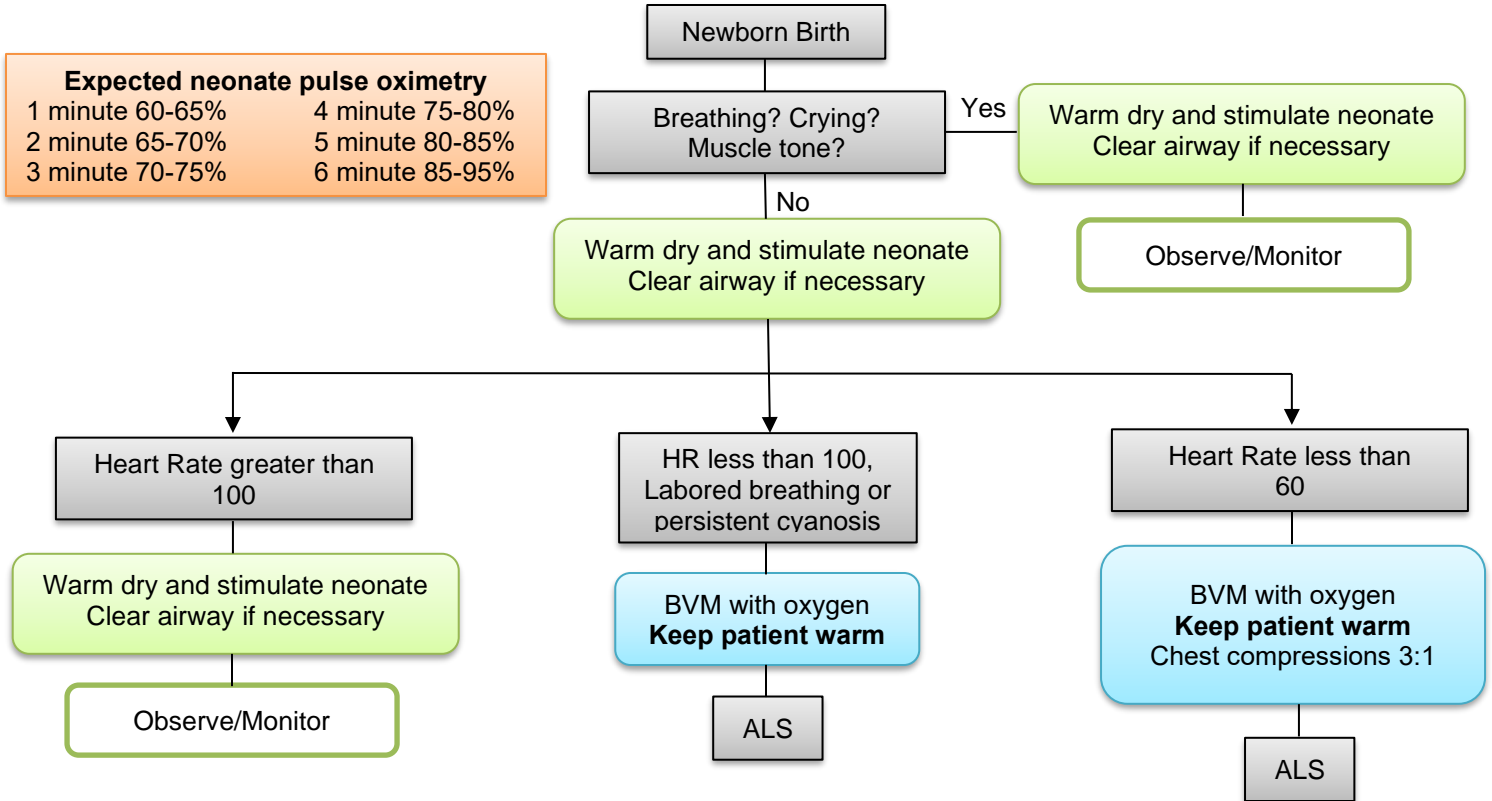

Expected neonate pulse oximetry

1 minute 60-65%	4 minute 75-80%
2 minute 65-70%	5 minute 80-85%
3 minute 70-75%	6 minute 85-95%

Blood Glucose:
Normal range 40-60 ml/dl
If hypoglycemic:
Use length based tape for dosing
Dextrose 10% 5ml/kg IV/IO

APGAR:
(at 1 and 5 minutes)

	0	2	3
Appearance	Blue/Pale	Peripheral Cyanosis	Pink
Pulse Rate	none	<100	>100
Grimace	none	Grimace	Cries
Activity	Limp	Some motion	Active
Respiration	Absent	Slow/Irregular	Good Cry